


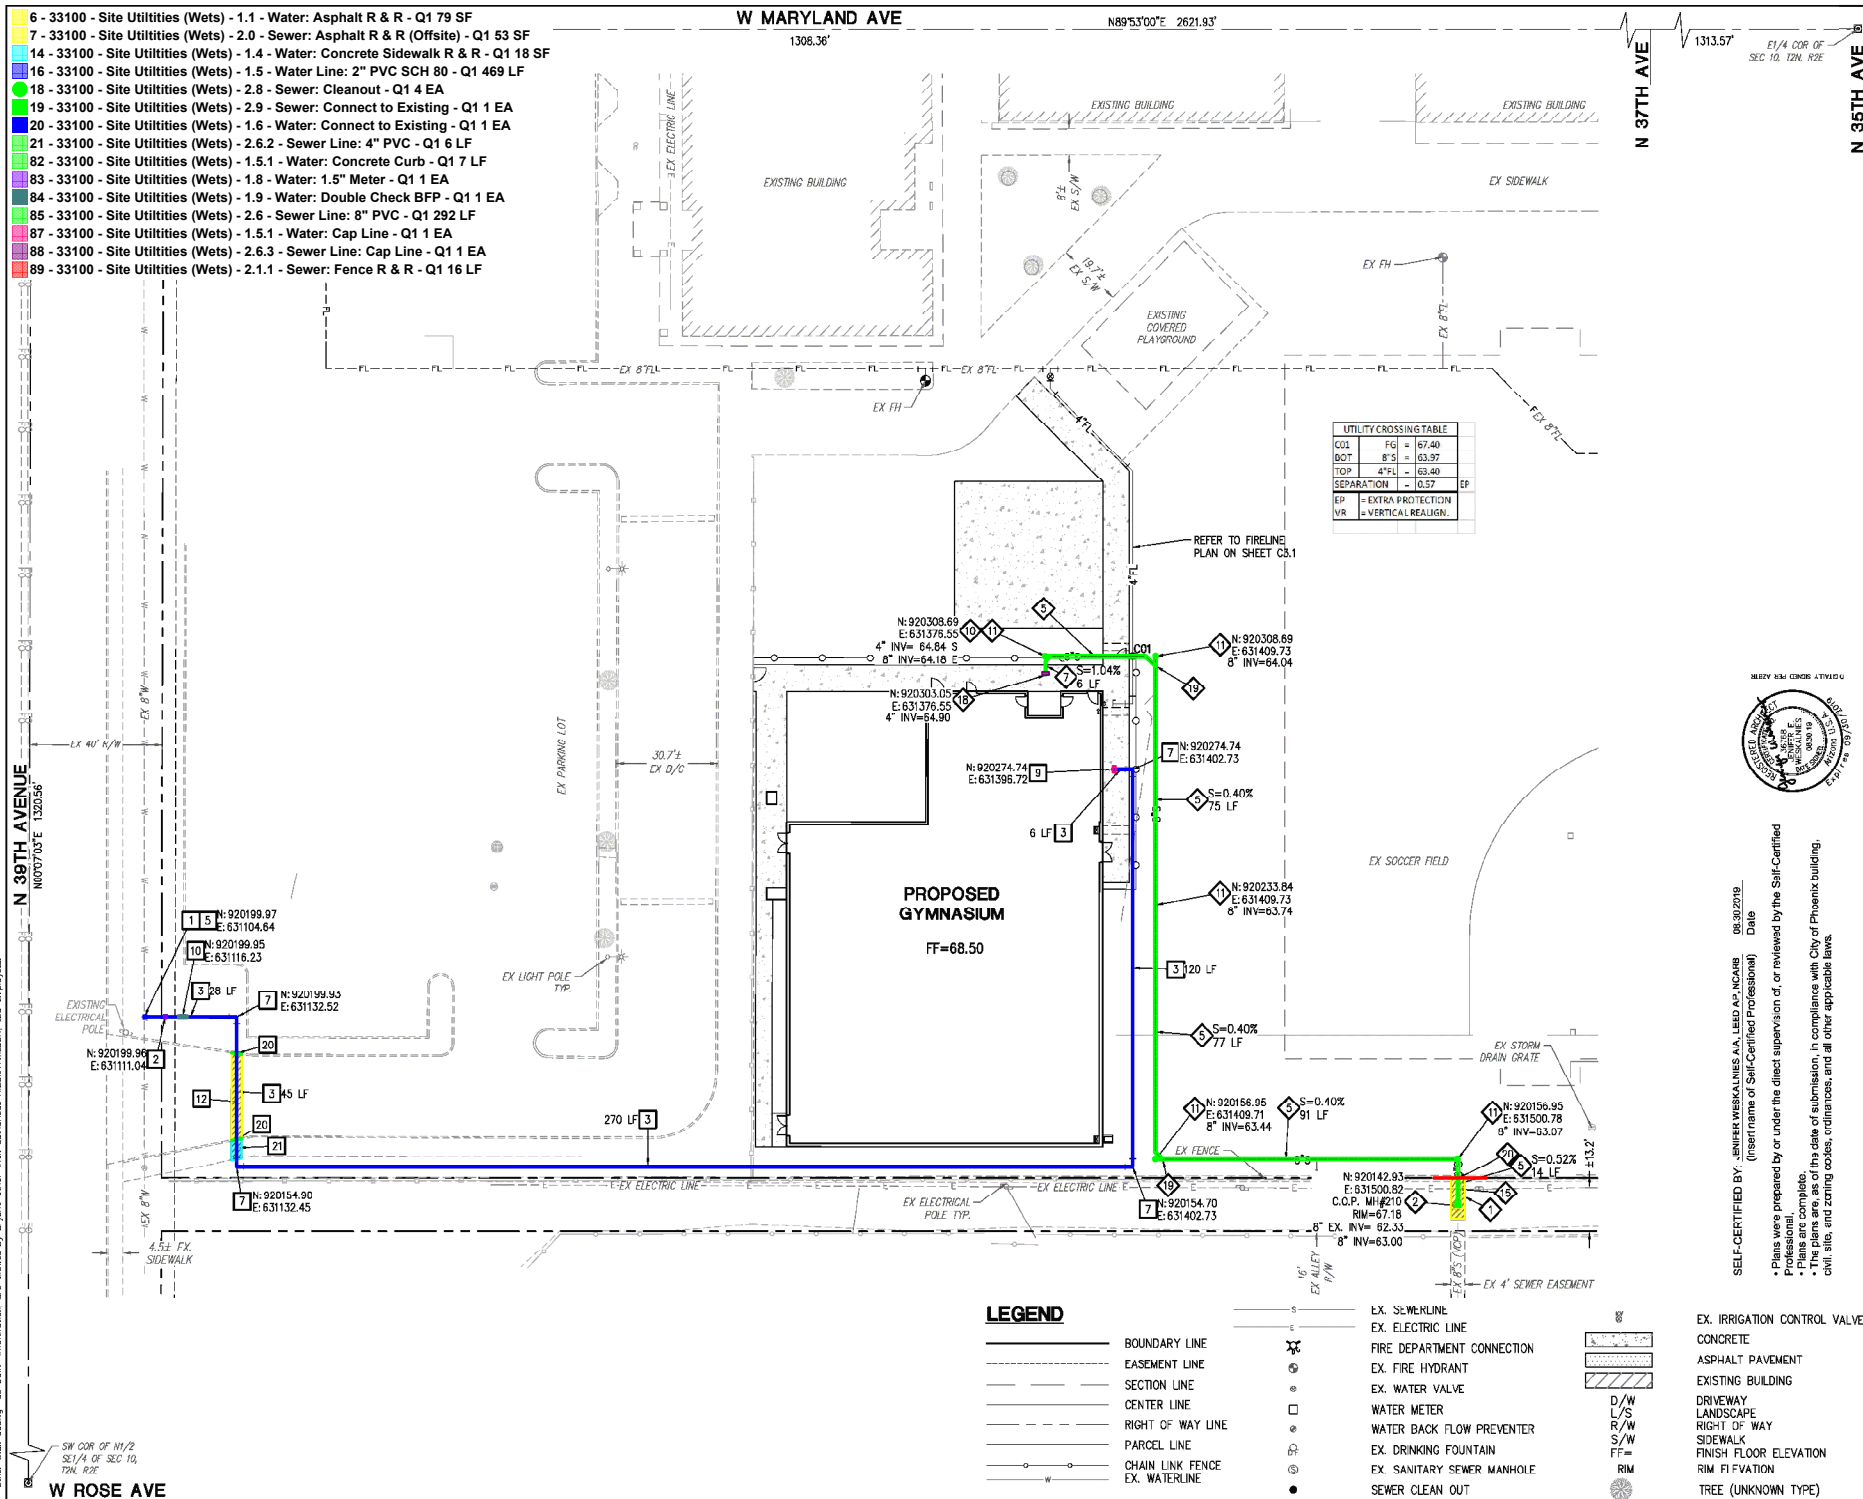

WATER CONSTRUCTION NOTES

1. CONNECT TO EXISTING WATER MAIN. CONTRACTOR TO VERIFY LOCATION AND DEPTH. DISCREPANCIES.
2. INSTALL 1.5" WATER METER & P-1363 CONNECT 2" W. DTL. P-1342 & MAG SPEC
3. INSTALL 2" PVC SCH 80 W. TEE
4. INSTALL 2" X 8" TEE
5. INSTALL 2" X 90 BEND
6. INSTALL 2" WATER LINE C/C PLANS FOR CONTINUATION.
7. SAWCUT, REMOVE, AND REPAIR PAVEMENT PER MAG SPEC P-1200 TYPE B, OR REPLACEMENT IS GREATER.
8. SAWCUT, REMOVE, AND REPAIR SIDEWALK PER MAG STD D.

SEWER CONSTRUCTION NOTES

1. SAWCUT, REMOVE, AND REPAIR PAVEMENT PER MAG SPEC P-1200 TYPE B, OR REPLACEMENT IS GREATER.
2. CONNECT TO EXISTING SEWER MAIN. CONTRACTOR TO VERIFY LOCATION AND DEPTH. DISCREPANCIES.
3. INSTALL 6" PVC (SDR 35) (LENGTH AND SLOPE AS SHOWN)
4. INSTALL 4" PVC (SDR 35) (LENGTH AND SLOPE AS SHOWN)
5. INSTALL CLEANOUT PER 2015 UPC
6. CAUTION! EX. UNDERGROUND. VERIFY LOCATION AND DEPTH.
7. INSTALL SEWER CAP.
8. INSTALL 8" X 8" WYE.
9. REMOVE AND REPLACE EXISTING

UTILITY CROSSING TABLE

COL	FG	FG	FG
TOP	8" FL	63.97	
SEPARATION	0.57		

EP = EXTRA PROTECTION
VR = VERTICAL REALIGN.

SELF-CERTIFIED BY: SENIOR MECHANICAL A.A. LEBE A.P. NCARB (insert name of Self-Certified Professional)
Date: 08/30/2019

Plans were prepared by or under the direct supervision of, or reviewed by the Self-Certified Professional.
• Plans are complete.
• The plans are, as of the date of submission, in compliance with City of Phoenix building, civil, site, and zoning codes, ordinances, and all other applicable laws.

NEW CATALINA GYMNASIUM
6331 N. 39TH AVENUE
UTILITIES

PROJ. NO.	DATE	SCALE	DESIGNED	DRAWN
212	SEP 2019	1"=20'	MH	